
GE FRAME 6® GAS TURBINE GENERATOR DRIVE APPLICATION CONTROL PACKAGE



MAY 2012



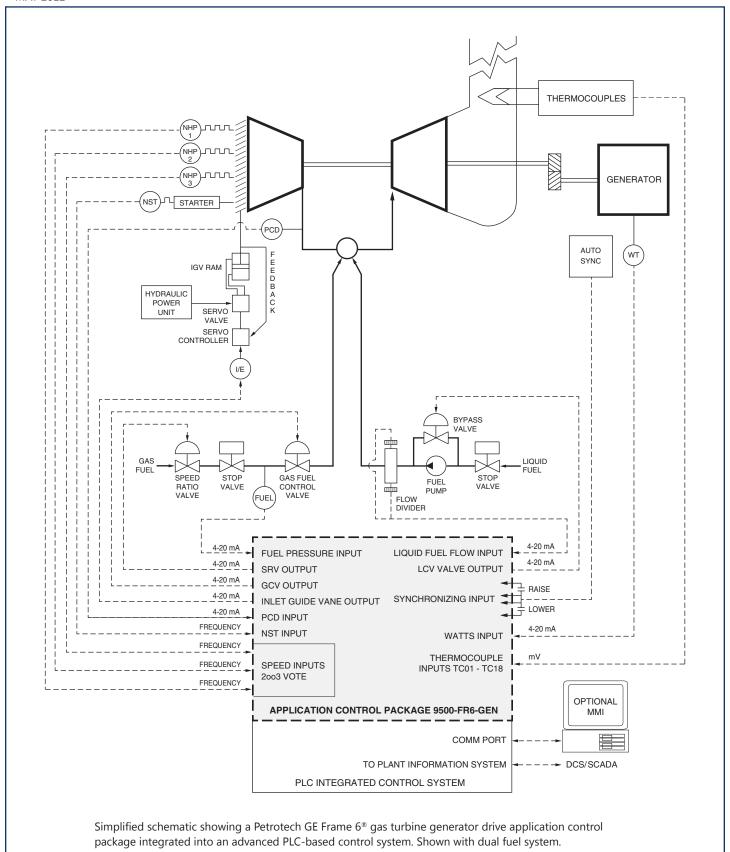

APPLICATION

The GE Frame 6® gas turbine gen set application control package replaces older mechanical/hydraulic/electronic/pneumatic gas turbine fuel regulators with a modern, reliable application control package which runs on an open architecture advanced PLC-based system. The control package for the gas turbine provides on-line dual fuel control, speed ratio control, and inlet guide vane control based on temperature.

ADVANTAGES

• Hardware independent system:

Application control package's portability allows customer choice of platform, reducing need for additional spare parts and training expenses. Available PLCs include General Electric, Siemens/TI, Allen-Bradley, and Modicon.

· Fault tolerant:

Control package is available on fault tolerant controllers for critical control applications.

Simplified interface to DCS or SCADA:

Communication tasks are handled with a separate, dedicated module in the PLC, increasing data rate and simplifying network installation.

• Improved fuel regulation:

Fast loop sampling rate, combined with modern digital control techniques, improves steady-state setpoint control, and reduces overshoot during transients, allowing full load rejection without driving the unit into overspeed.

• Improved start-up reliability:

Special "lean lightoff" procedure ignites all burners with essentially 100% reliability, and with greatly reduced thermal stress.

• Improved exhaust temperature monitoring and control:

Advanced statistical algorithms detect turbine hot/cold spots and automatically reject failed thermocouples.

· Fail-safe features:

Redundant overspeeds; open/short monitoring of mA and thermocouples; readback monitoring of outputs, and special self-check features improve safety.

• Non-proprietary interfaces:

Simple 4-20 mA, RTD, thermocouple, and dry contact I/O allow simple interface to existing sequence/protection logic unit, making low-cost partial upgrades practical, and system troubleshooting simple.

• Improved operator information with optional MMI:

Optional Man-Machine Interface MS Windows-based graphic operator interface displays system status, trending and data logging, which can be used as part of a preventive maintenance program.

SCOPE OF SUPPLY

The application control package for GE Frame 6® gas turbine generator drive system, includes:

Analog inputs, 4-20 mA:

- Watts (load control)
- · Compressor discharge pressure (PCD)
- Fuel interstage pressure

Analog inputs, frequency:

- Three (3) redundant NHP
- · One (1) starter speed

Analog inputs, mV:

• EGT (up to 18 thermocouples)

Analog outputs, 4-20 mA:

- · Speed ratio valve position setpoint
- · Fuel control valve position setpoint
- Inlet guide vane position setpoint (if applicable)

Operating states:

- Firing
- · Warm-up
- Accelerate
- Load
- Upset

Status, alarms, and shutdowns:

- Fault
- · NHP overspeed alarm
- · NHP underspeed alarm
- · NHP overspeed shutdown
- · Redundant NHP overspeed shutdown
- △NHP alarm
- · High EGT alarm
- · High EGT shutdown
- · Low EGT shutdown
- Rejected thermocoupleToo few thermocouples shutdown
- △T alarm
- △T shutdown
- · Thermocouple spread alarm
- Thermocouple spread shutdown
- · Turbine maximum limit
- · Turbine minimum limit
- NHP speed #1
- NHP speed #2
- NHP speed #3
- NHP speed #4
- NHP speed #5
- EGT switch #1
- · Bolt test
- Manual
- · Starter overspeed
- · Starter zero speed
- · High firing fuel pressure shutdown



SCOPE OF SUPPLY-Continued

- · PCD bias active
- · Flow following error
- · Transmitter failure alarms
- · Transmitter failure shutdowns
- · Output failure shutdowns
- · Control mode

Controllers/special features:

- Start-up controller for fuel valve
- · NHP controller for fuel valve
- NHP acceleration controller for fuel valve
- · EGT controller for fuel valve
- EGT rate of rise controller for fuel valve
- EGT controller for inlet guide vanes (if applicable)
- · Combustion monitoring system
- · Dual fuel capability with on-line transfer

Ramps:

- Firing (lean lightoff) ramp
- Start-up ramp
- · Loading ramp
- · Cooldown ramp

Does not include:

- · PLC hardware
- · Gas turbine sequencing and protection discrete logic
- · Generator sequencing and protection discrete logic
- Synchronizing and regulation equipment
- End elements

OPTIONS FOR COMPLETE CONTROL SYSTEM UPGRADE

- Gas turbine sequencing and protection discrete logic
- · Generator sequencing and protection discrete logic
- Communication interface to DCS or SCAD
- · PLC hardware
- Man machine interface unit with WonderWare InTouch® licensed software package
- Complete custom engineered control panel, factory tested and ready to install
- Fuel valve system upgrade
- · Inlet guide vanes actuator system upgrade or retrofit
- · Thermocouple upgrade
- Flame sensor upgrade
- · Vibration system upgrade
- · Installation and commissioning
- Training

Petrotech, Inc. 151 Brookhollow Esplanade New Orleans, Louisiana 70123 Phone: (504) 620-6600 Fax: (504) 620-6601 Email: info@petrotechinc.com Website: www.petrotechinc.com